

SPONSOR: **ARTIZIN**
Garland, TX

Sound Absorption
RAL™-A24-430

CONDUCTED: 2024-11-01

Page 1 of 8

ON: ArtFelt™ Beam Baffle-Cube (16 units, 2 rows of 8 units each, rows spaced 1” apart, units in each row spaced 6” apart)

TEST METHODOLOGY

Riverbank Acoustical Laboratories™ is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2017 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-23: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-23: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request. The results presented in this report apply to the sample as received from the test sponsor.

INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as ArtFelt™ Beam Baffle-Cube (16 units, 2 rows of 8 units each, rows spaced 1” apart, units in each row spaced 6” apart). The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

Product Under Test

Product Name: ArtFelt™ Beam Baffle-Cube
Manufacturer: ARTIZIN

SPECIMEN MEASUREMENTS & TEST CONDITIONS

Through a full external visual inspection performed on the test specimen, Riverbank personnel verified the following information:

Test Specimen

Product Type: Baffles
Dimensions: 16 baffles @ 52 mm (2.0625 in.) wide by 1121 mm (44.125 in.) long
Thickness: 203 mm (8 in.)
Overall Weight: 26.08 kg (57.5 lbs)

ARTIZIN
2024-11-01

RAL™-A24-430
Page 2 of 8

SPECIMEN MEASUREMENTS & TEST CONDITIONS (continued)

Physical Measurements (per object)

Dimensions: 1.12 m (44.125 in) wide by 0.2 m (8.0 in) long
Thickness: 0.05 m (2.0625 in)
Weight: 1.63 kg (3.59 lbs)

Test Environment

Room Volume: 291.98 m³
Temperature: 21.7 °C ± 0.0 °C (Requirement: ≥ 10 °C and ≤ 5 °C change)
Relative Humidity: 59.4 % ± 0.8 % (Requirement: ≥ 40 % and ≤ 5 % change)
Barometric Pressure: 99.6 kPa (Requirement not defined)

Each sound absorbing object had an exposed surface area of 0.594 m² (6.40 ft²). The total exposed surface area of all sound-absorbing objects was 9.51 m² (102 ft²). These values are based on a simplification of the specimen object geometry to that of the smallest rectangular prism fully enclosing one object.

MOUNTING METHOD

Type JV-MOD Mounting: The specimen is an array of 16 spaced sound absorbing objects suspended from cables such that the closest face is located approximately 1143 mm (45 in.) from the horizontal test surface. This approximates the mounting method of a typical ceiling baffle installation. The objects were distributed in two rows of eight objects each, with rows spaced 25 mm (1 in.) apart, and objects in each row spaced 152 mm (6 in.) apart. The width of the installed object array was 1480 mm (58.25 in.) and the length of the installed object array was 2267 mm (89.25 in.). The area of extended continuous surface attributed to the object array was 3.74 m² (40.3 ft²).

ARTIZIN
2024-11-01

RAL™-A24-430
Page 3 of 8



Figure 1 – Specimen mounted in test chamber



Figure 2 – Detail of specimen materials

ARTIZIN
2024-11-01

RAL™-A24-430
Page 4 of 8

TEST RESULTS

The preferred presentation of sound absorption test results for arrays of spaced objects is sound absorption (m^2) per object and total sound absorption (m^2) at each one-third-octave band

ASTM C423-23 Appendix X2 allows calculation of sound absorption per m^2 (SA/m^2) based on the projected horizontal surface area attributable to an array of objects. The extended continuous surface area used in this calculation is to be determined using the following procedure:

$S_{array} = (w + w_1) \times (l + l_1)$ If the set of objects consists of a rectangular array of equal sized objects with equal space between each object in a row and equal space between rows. (ASTM E423-23 X.2.3.1)

Where:

S_{array} = area of extended continuous surface attributed to the test specimen, m^2

w = the measured width of the installed object array, in meters

w_1 = the space between objects in the array along the width, in meters

l = the measured length of the installed object array, in meters

l_1 = the space between objects in the array along the length, in meters

The sound absorption per m^2 (SA/m^2) is calculated based on the following formula:

$$\alpha_{array} = (A_2 - A_1) / S_{array}$$

Where:

α_{array} = sound absorption per m^2 (SA/m^2) of extended continuous surface, no units,

A_1 = absorption of the empty reverberation room, m^2 and

A_2 = absorption of the room after the specimen has been installed, m^2 .

S_{array} = area of extended continuous surface attributed to the test specimen, m^2

ARTIZIN
2024-11-01

RAL™-A24-430
Page 5 of 8

TEST RESULTS (continued)


| 1/3 Octave Center Frequency (Hz) | Total Absorption | | Absorption per Object | | α_{array} (Sabins/ft ²) (SA/m ²) |
|--|-------------------|----------|---------------------------|-------------------|---|
| | (m ²) | (Sabins) | (m ² / Object) | (Sabins / Object) | |
| 100 | 0.27 | 2.94 | 0.02 | 0.18 | 0.07 |
| ** 125 | 0.36 | 3.89 | 0.02 | 0.24 | 0.10 |
| 160 | 0.49 | 5.25 | 0.03 | 0.33 | 0.13 |
| 200 | 0.83 | 8.88 | 0.05 | 0.56 | 0.22 |
| ** 250 | 1.26 | 13.59 | 0.08 | 0.85 | 0.34 |
| 315 | 1.89 | 20.39 | 0.12 | 1.27 | 0.51 |
| 400 | 2.35 | 25.29 | 0.15 | 1.58 | 0.63 |
| ** 500 | 2.96 | 31.85 | 0.18 | 1.99 | 0.79 |
| 630 | 3.46 | 37.21 | 0.22 | 2.33 | 0.92 |
| 800 | 3.82 | 41.09 | 0.24 | 2.57 | 1.02 |
| ** 1000 | 4.85 | 52.23 | 0.30 | 3.26 | 1.30 |
| 1250 | 5.90 | 63.54 | 0.37 | 3.97 | 1.58 |
| 1600 | 6.65 | 71.54 | 0.42 | 4.47 | 1.78 |
| ** 2000 | 7.30 | 78.58 | 0.46 | 4.91 | 1.95 |
| 2500 | 7.36 | 79.18 | 0.46 | 4.95 | 1.97 |
| 3150 | 7.19 | 77.40 | 0.45 | 4.84 | 1.92 |
| ** 4000 | 7.25 | 78.04 | 0.45 | 4.88 | 1.94 |
| 5000 | 7.05 | 75.88 | 0.44 | 4.74 | 1.88 |

Array-NRC 1.10 over 3.74 m² of extended continuous surface area

Array-SAA 1.08 over 3.74 m² of extended continuous surface area

Tested by 
Marc Sciaky
Senior Experimentalist

Report by 
Keith Kimberling
Test Engineer


Approved by 
Eric P. Wolfram
Laboratory Manager

Digitally signed by Eric P Wolfram
Date: 2024.11.12 13:17:41 -0600

Note: Sound absorption per m² (SA/m²), and therefore the reported Single Number Ratings, are highly dependent on the exact sample shape, size, spacing, and extended continuous surface area present in the test and subsequent calculations. Changes to any of these parameters will change the resulting values. These presented results are valid only for the specific configuration present in this test.

SOUND ABSORPTION REPORT

ArtFelt™ Beam Baffle-Cube (16 units, 2 rows of 8 units each, rows spaced 1” apart, units in each row spaced 6” apart)

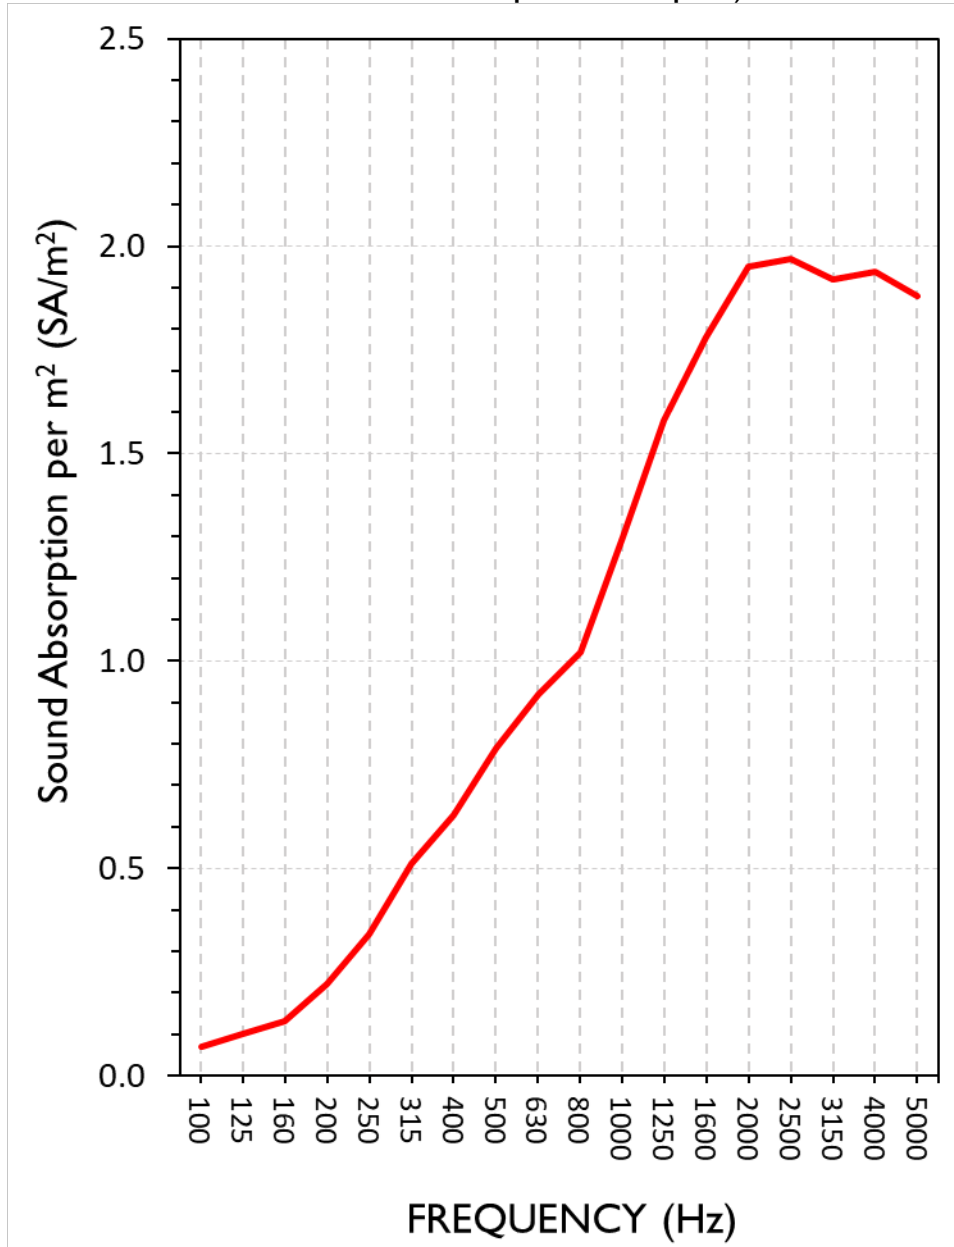

Array-NRC 1.10 over 3.74 m² of extended continuous surface area

Array-SAA 1.08 over 3.74 m² of extended continuous surface area



Test Report

ARTIZIN
 2024-11-01

RAL™-A24-430
 Page 7 of 8

APPENDIX A: Extended Frequency Range Data

Specimen: ArtFelt™ Beam Baffle-Cube (16 units, 2 rows of 8 units each, rows spaced 1” apart, units in each row spaced 6” apart) (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-23, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

| 1/3 Octave Band Center Frequency (Hz) | Total Absorption | | Absorption per Object | | α_{array} (Sabins/ft ²) |
|---|-------------------|----------|---------------------------|-------------------|---|
| | (m ²) | (Sabins) | (m ² / Object) | (Sabins / Object) | (SA/m ²) |
| 31.5 | -0.08 | -0.82 | 0.00 | -0.05 | -0.02 |
| 40 | -0.07 | -0.75 | 0.00 | -0.05 | -0.02 |
| 50 | 0.68 | 7.36 | 0.04 | 0.46 | 0.18 |
| 63 | -0.02 | -0.16 | 0.00 | -0.01 | 0.00 |
| 80 | -0.02 | -0.24 | 0.00 | -0.02 | -0.01 |
| 100 | 0.27 | 2.94 | 0.02 | 0.18 | 0.07 |
| 125 | 0.36 | 3.89 | 0.02 | 0.24 | 0.10 |
| 160 | 0.49 | 5.25 | 0.03 | 0.33 | 0.13 |
| 200 | 0.83 | 8.88 | 0.05 | 0.56 | 0.22 |
| 250 | 1.26 | 13.59 | 0.08 | 0.85 | 0.34 |
| 315 | 1.89 | 20.39 | 0.12 | 1.27 | 0.51 |
| 400 | 2.35 | 25.29 | 0.15 | 1.58 | 0.63 |
| 500 | 2.96 | 31.85 | 0.18 | 1.99 | 0.79 |
| 630 | 3.46 | 37.21 | 0.22 | 2.33 | 0.92 |
| 800 | 3.82 | 41.09 | 0.24 | 2.57 | 1.02 |
| 1000 | 4.85 | 52.23 | 0.30 | 3.26 | 1.30 |
| 1250 | 5.90 | 63.54 | 0.37 | 3.97 | 1.58 |
| 1600 | 6.65 | 71.54 | 0.42 | 4.47 | 1.78 |
| 2000 | 7.30 | 78.58 | 0.46 | 4.91 | 1.95 |
| 2500 | 7.36 | 79.18 | 0.46 | 4.95 | 1.97 |
| 3150 | 7.19 | 77.40 | 0.45 | 4.84 | 1.92 |
| 4000 | 7.25 | 78.04 | 0.45 | 4.88 | 1.94 |
| 5000 | 7.05 | 75.88 | 0.44 | 4.74 | 1.88 |
| 6300 | 7.07 | 76.11 | 0.44 | 4.76 | 1.89 |
| 8000 | 6.94 | 74.71 | 0.43 | 4.67 | 1.86 |
| 10000 | 6.80 | 73.16 | 0.42 | 4.57 | 1.82 |
| 12500 | 7.08 | 76.25 | 0.44 | 4.77 | 1.89 |



®RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

627 RIVERBANK DRIVE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

ARTIZIN
2024-11-01

RAL™-A24-430
Page 8 of 8

APPENDIX B: Instruments of Traceability

Specimen: ArtFelt™ Beam Baffle-Cube (16 units, 2 rows of 8 units each, rows spaced 1” apart, units in each row spaced 6” apart) (See Full Report)

| <u>Description</u> | <u>Model</u> | <u>Serial Number</u> | <u>Date of Certification</u> | <u>Calibration Due</u> |
|--------------------------------|-----------------|----------------------|------------------------------|------------------------|
| System 1 | Type 3160-A-042 | 3160-106974 | 2024-08-15 | 2025-08-15 |
| Bruel & Kjaer Mic And Preamp G | Type 4943-B-001 | 2525858 | 2024-05-07 | 2025-05-07 |
| Bruel & Kjaer Pistonphone | Type 4228 | 2781248 | 2024-07-19 | 2025-07-19 |
| EXTECH Hygro 959 | SD700 | A099959 | 2024-03-29 | 2025-03-29 |

APPENDIX C: Revisions to Original Test Report

Specimen: ArtFelt™ Beam Baffle-Cube (16 units, 2 rows of 8 units each, rows spaced 1” apart, units in each row spaced 6” apart) (See Full Report)

| <u>Date</u> | <u>Revision</u> |
|-------------|------------------------|
| 2024-11-08 | Original report issued |

END



NVLAP LAB CODE 100227-0

®RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.